	
	YW-20190404-001
IM267	2019-04-04
	1 15

IM267

IM267

: 135 7383 0623

QQ:1774880258


RV2025

2755

<http://www.jnrovin.com>





	
	YW-20190404-001
IM267	2019-04-04
	4 15

	20.4-28.8V DC
	2A
	500V
5V DC	1500mA
x x	71 x 80 x 62

1.4

IP


1.5


IM267 IM267 GSDML IM 267 GSDML " PROFINET

IM267 GSDML "  IM267

PROFINET S7-200 I/O IM267 LAN

PROFINET

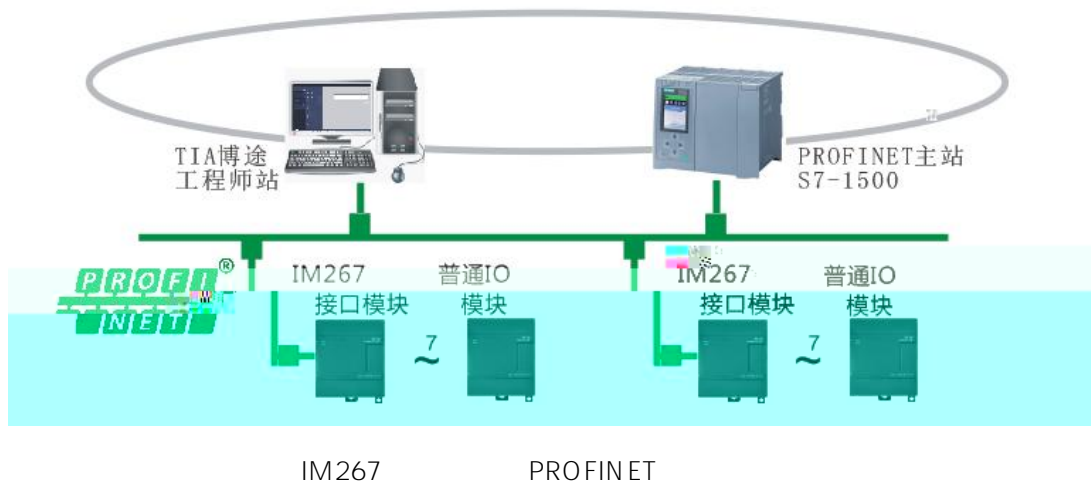

	
	YW-20190404-001
IM267	2019-04-04
	5 15

1.6 LED

IM267 LED

		—	
		—	
	0/	—	
	,	,	

2 TIA V15 IM267
IM267 S7-1215C PROFINET CPU
1200 IM267 I/O TIA Portal V15

2.1

IM267

S7-1200CPU

200 222-1PL22 + 222-1HH22 + 232-0HD22 + 231-7PC22

PROFINET

2.2

2.2.1

1 TIA Portal 1200




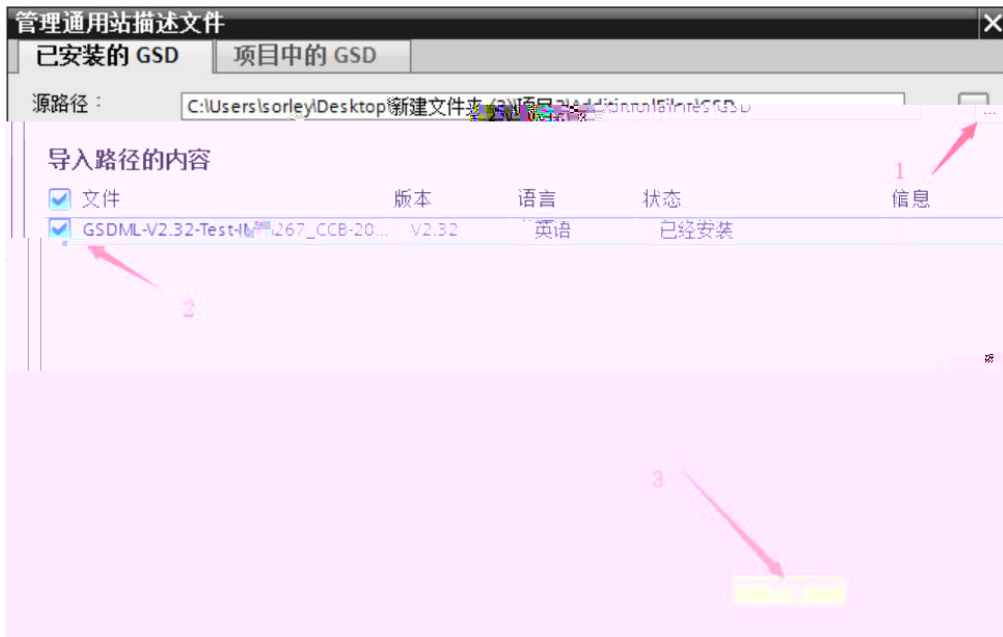
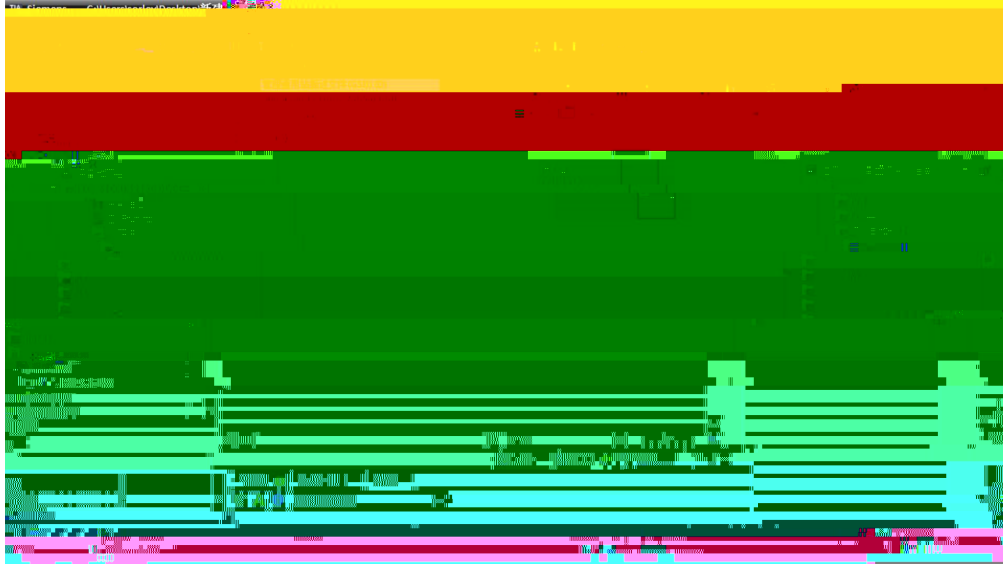



YW-20190404-001

IM267



	
	YW-20190404-001
IM267	2019-04-04
	7 15



	
	YW-20190404-001
IM267	2019-04-04
	8 15




4


PLC IM267

PN/IE_1


IP




	
	YW-20190404-001
IM267	2019-04-04
	9 15

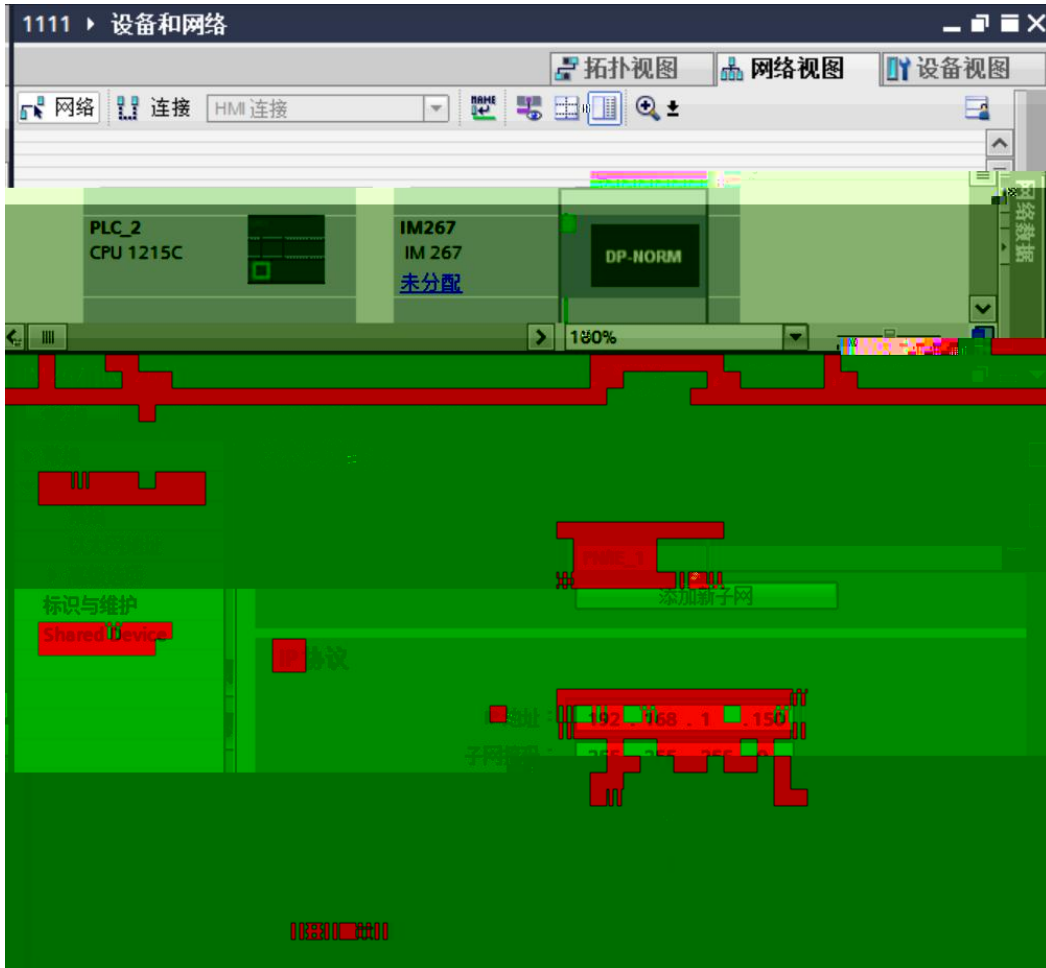

CPU ,

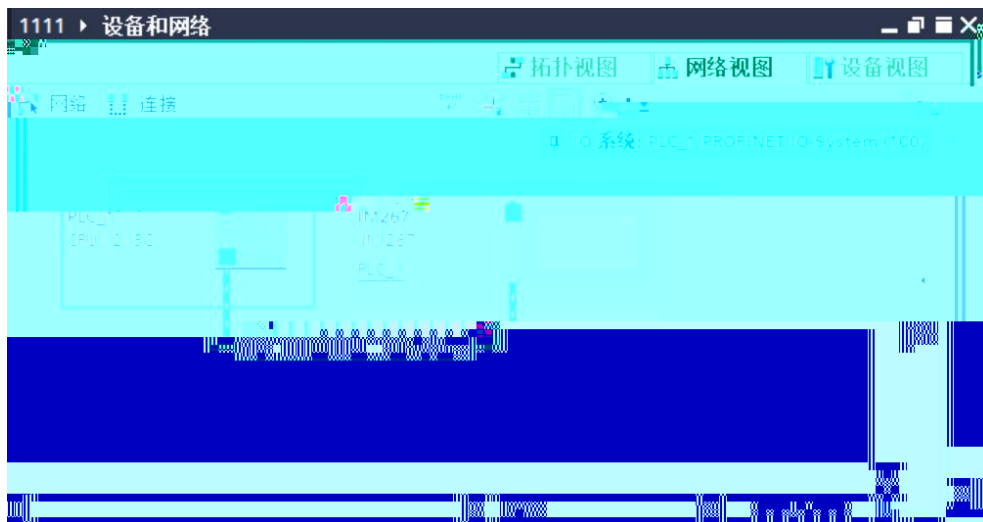

	
	YW-20190404-001
IM267	2019-04-04
	10 15

5



6 IM267

IP

4


267

IP


IP

IM267- -

IM267

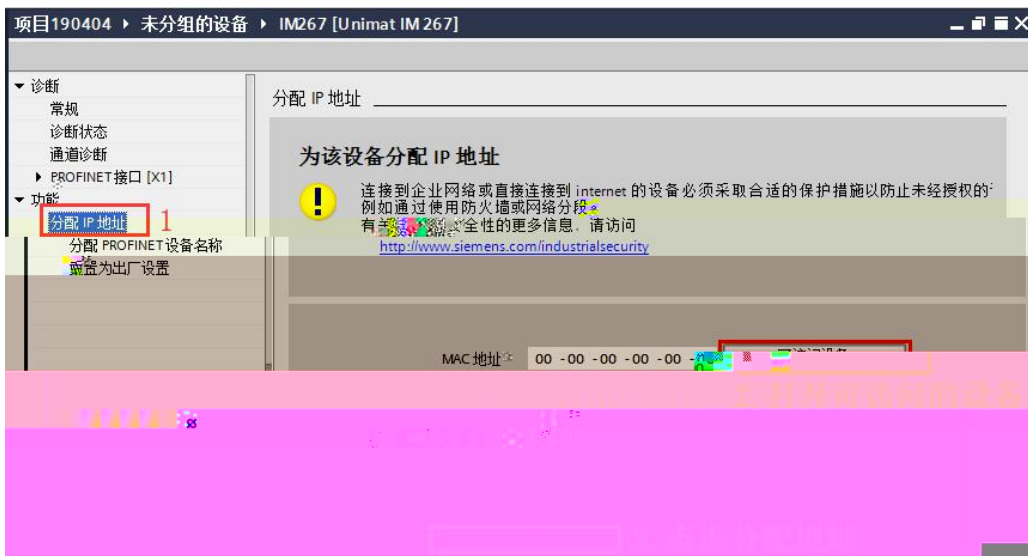




	
	YW-20190404-001
IM267	2019-04-04
	12 15

8

CPU

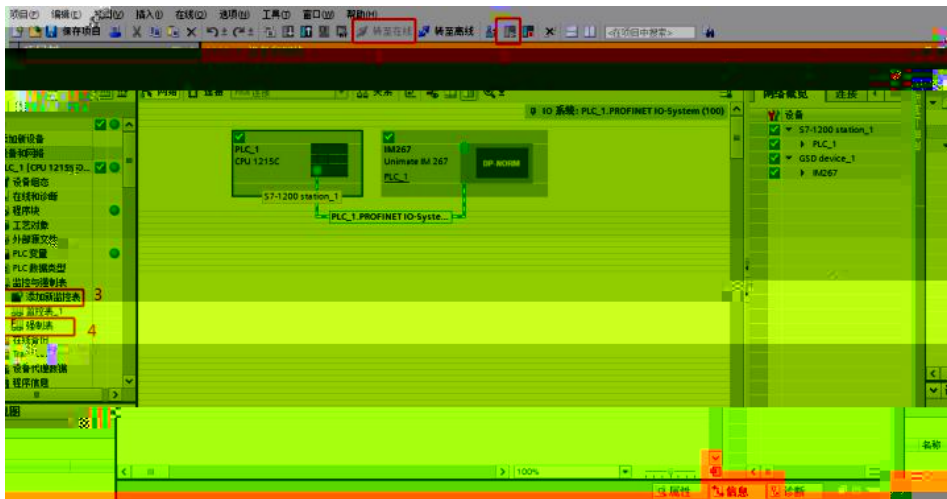

9

QW10,QW14 16000


5V,10mA

IW42

10


200PLC




	
	20190404-001
IM267	9-04-04

B



	
	YW-20190404-001
IM267	2019-04-04
	15 15

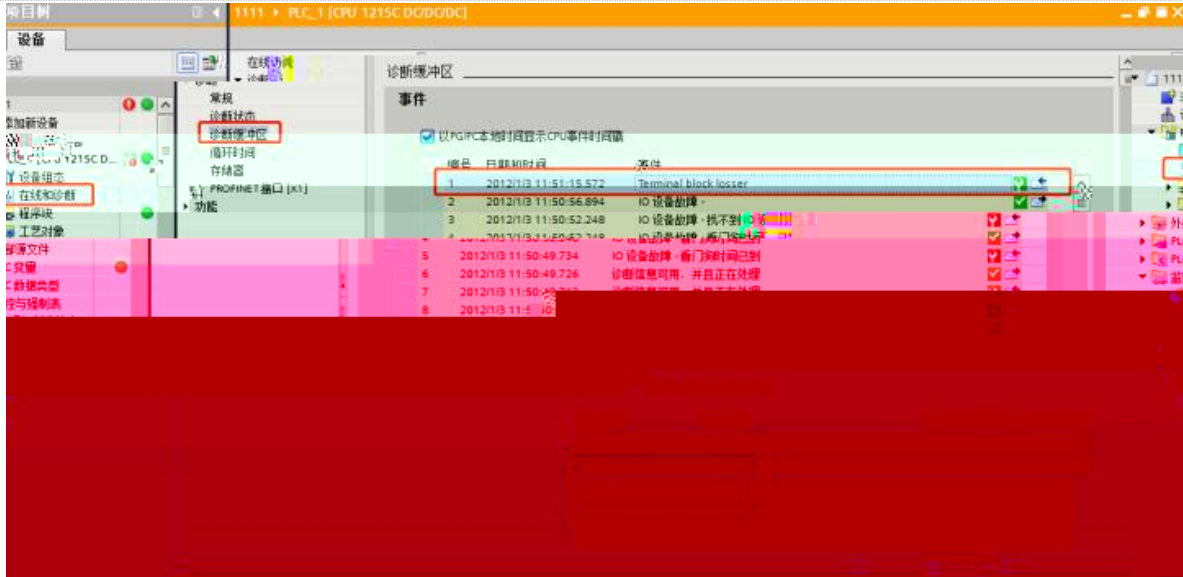

- Terminal block loss—
- Blown fuse Err—
- No user power Err—
- Out of-range Err—
- Bus Fault or parity err—
- Config Mask—

4

IM267

